



SLOPE DRAIN, BASE DITCH OR BERM DRAINAGE
OUTLET DITCH

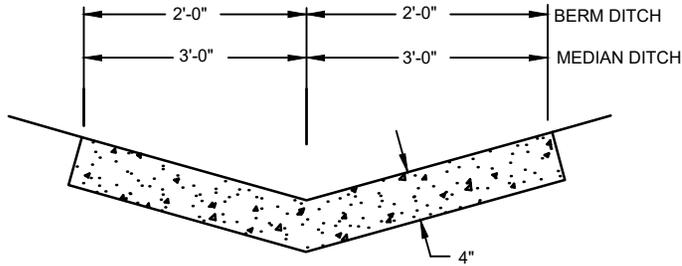


MEDIAN OR BERM DITCH

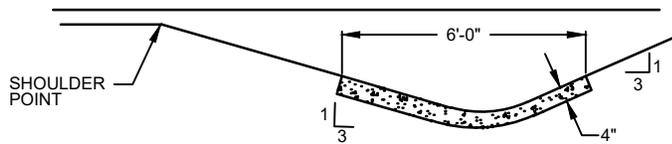

SIDE DITCH


NOTES:

1. IN THE 4" CONCRETE PAVED DITCHES PLACE 1/2" EXPANSION JOINT AT 30 FT INTERVALS AND AT ALL OTHER POINTS WHERE PROPOSED DITCHES ABUT RIGID OBJECTS. PLACE GROOVED JOINTS 1" DEEP AT 10' INTERVALS BETWEEN EXPANSION JOINTS.
2. WIDTH AND SHAPE OF PROPOSED 4" CONCRETE PAVED DITCHES SHALL BE AS SHOWN OR AS DIRECTED BY THE ENGINEER.
3. ALL CONCRETE TO BE 3600 P.S.I. COMPRESSIVE STRENGTH.

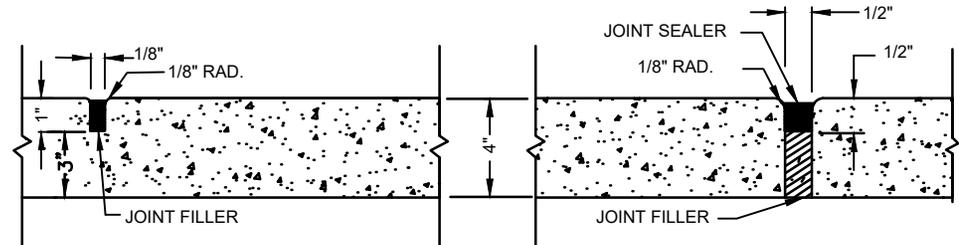

SHOWING GROOVED JOINT

SHOWING EXPANSION JOINT

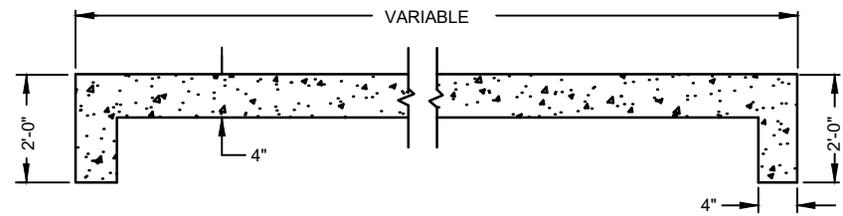

LONGITUDINAL SECTION OF PAVED DITCH

SHOWING 2'-0" CURTAIN WALL REQUIRED AT EACH END



TOWN OF INDIAN TRAIL
STANDARD DETAIL

CONCRETE PAVED DITCHES

REVISIONS	Scale
	Not To Scale
	Revision Date
	02/2021
	Detail #
	SW_9.01